

# Produktdatenblatt

Spezifikationen



## Digitale Lizenz, PowerChute Network Shutdown für Virtualisierung und HCI, 6-Jahres-Lizenz

SWPCNS6Y-DIGI

### Übersicht

<b>Ausführung</b>	6-year license for PowerChute Network Shutdown. Contact your Partner to purchase this license.
<b>Lieferzeit</b>	Normalerweise auf Lager

### Hauptmerkmale

<b>Baureihe</b>	PowerChute Network Shutdown
<b>Produkt- oder Komponententyp</b>	Software license
<b>Subscription period</b>	6 years
<b>Format</b>	Digitaler Schlüssel
<b>Subscription type</b>	Paid
<b>Softwaretyp</b>	Lizenz
<b>Lizenztyp</b>	Digital
<b>Kompatible Produktfamilie</b>	Easy UPS On-Line Smart-UPS Smart-UPS Ultra Smart-UPS Online Smart-UPS Modular Ultra
<b>Number of input phases</b>	1 3
<b>Operating system requirement</b>	VMware ESXi VMware vSAN Nutanix ESXi Nutanix AHV Dell VxRail HPE SimpliVity Cisco HyperFlex
<b>Benutzersprache</b>	Englisch

### Zusatzmerkmale

<b>Bezeichnung der Software</b>	PowerChute Network Shutdown software
<b>Funktion der Software</b>	Activate PowerChute Network Shutdown


### Vertragliche Gewährleistung

<b>Gewährleistung</b>	18 Monate
-----------------------	-----------

Bruttopreisliste für Deutschland zuzüglich Zuschläge, Frachtkosten und Mehrwertsteuer, gültig ab dem 1. Januar 2024. Irrtum und Änderungen vorbehalten. Es gelten die AGBs der Schneider Electric GmbH.

Image of product / Alternate images

Alternative


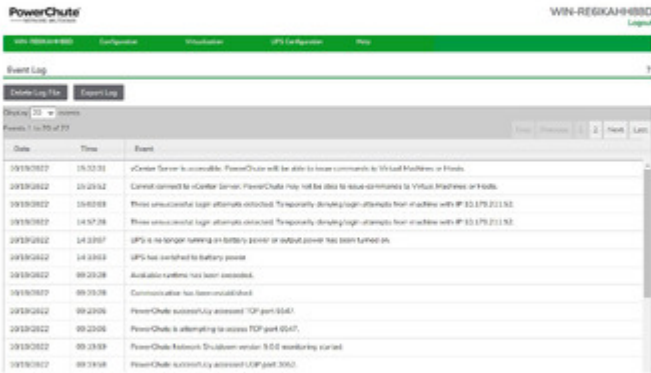


The screenshot shows the PowerChute software interface for a device labeled 'WIN-REGKAH88SD'. The 'Event Log' section is active, displaying a list of events with columns for Date, Time, and Event. The events include messages about vCenter Server accessibility, connection status to vCenter Server, login attempts from IP 10.179.211.52, UPS switching to battery power, and communication status with a UPS port (0547).

Date	Time	Event
09/19/2022	15:52:51	vCenter Server is accessible. PowerChute will be able to issue commands to VMs and Hosts in vCenter.
09/19/2022	15:29:52	Cannot connect to vCenter Server. PowerChute may not be able to issue commands to VMs and Hosts in vCenter.
09/19/2022	15:02:08	These unauthorized login attempts detected. To temporarily disable login attempts from IP address with IP 10.179.211.52.
09/19/2022	14:57:38	These unauthorized login attempts detected. To temporarily disable login attempts from IP address with IP 10.179.211.52.
09/19/2022	14:23:07	UPS is no longer running on battery power or output power has been turned on.
09/19/2022	14:23:07	UPS has switched to battery power.
09/19/2022	09:29:28	Available runtime has been exceeded.
09/19/2022	09:29:28	Communication has been established.
09/19/2022	09:29:06	PowerChute automatically assessed TCP port 0547.
09/19/2022	09:29:06	PowerChute is attempting to access TCP port 0547.
09/19/2022	09:19:59	PowerChute Network Shutdown vendor 5.00 monitoring started.
09/19/2022	09:19:58	PowerChute successfully assessed TCP port 3062.





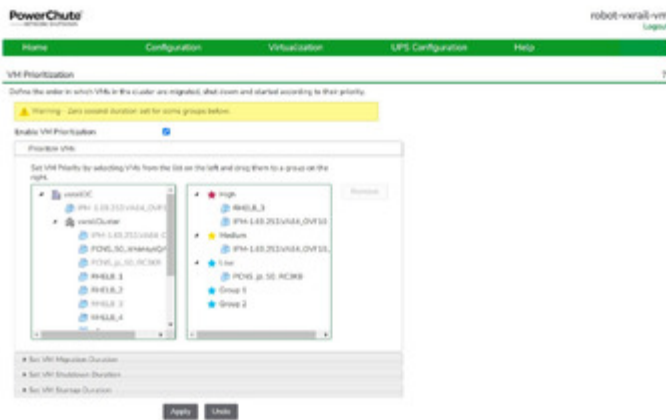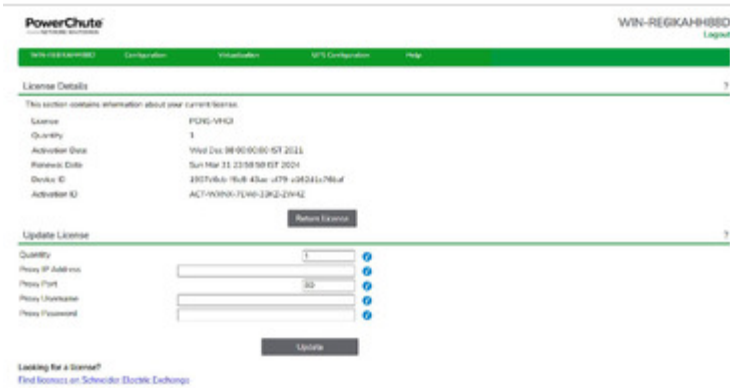

PowerChute robot-vxrail-vm  
Logout

---

Home Configuration Virtualization UPS Configuration Help

---

**vCenter Server Details** ?

vCenter Server Protocol:

vCenter Server Port:

vCenter Server IP Address/Hostname:

vCenter Server Username:

vCenter Server Password:

vCenter Server running on a VM:

PowerChute vSphere thick Disk Plug-in:

PowerChute vSphere Plug-in:

---

**Virtual Manager Details** ?

Virtual Manager Details are required to perform graceful shutdown of the Cluster.

Virtual Manager IP Address/QDN:

---

**PowerChute Access** ?

Select the access level for the user interface.

Protocol:

---

**PowerChute Security** ?

The information below is used to log in to PowerChute Network Shutdown and for authentication with the Network Management Card.

Administrator Username:

Administrator Password:

Administrator Authentication Phase: